


Results Overall Estate		Results Entrance Way		Results Spine Road		Results Estate - North		Results Estate - Western Side		Results Estate - Eastern Side		Results Estate - South		Results Estate - Southern Walkway		Results Estate - Rear Block		Results Estate - Northern Pass			
Eav	7.15	Eav	7.72	Eav	7.89	Eav	7.39	Eav	4.79	Eav	7.35	Eav	6.95	Eav	6.42	Eav	6.09	Eav	6.68		
Emin	0.45	Emin	1.46	Emin	1.87	Emin	1.68	Emin	1.90	Emin	2.15	Emin	2.46	Emin	2.12	Emin	2.10	Emin	0.27		
Emax	23.67	Emax	20.69	Emax	15.96	Emax	15.87	Emax	11.64	Emax	15.44	Emax	12.73	Emax	16.07	Emax	11.27	Emax	24.44		
Emin/Emax	0.02	Emin/Emax	0.07	Emin/Emax	0.12	Emin/Emax	0.11	Emin/Emax	0.16	Emin/Emax	0.14	Emin/Emax	0.19	Emin/Emax	0.13	Emin/Emax	0.19	Emin/Emax	0.01		
Emin/Eav	0.06	Emin/Eav	0.19	Emin/Eav	0.24	Emin/Eav	0.23	Emin/Eav	0.40	Emin/Eav	0.29	Emin/Eav	0.28	Emin/Eav	0.35	Emin/Eav	0.33	Emin/Eav	0.34	Emin/Eav	0.04

Supplier	Luminaire A	Luminaire B	Luminaire C
Type	Philips BGP702 DW90	BDS592 MDS LED40/30 NO	PHAROS 8 Symmetrical 81 FPN 350mA NY Commercial PC Flood
Lamp(s)	LED-HB 5.25 730	LED40-3S/30	8 LEDs NW
Lamp Flux (lm)	5.00	4.00	0.65
Maintenance Factor	0.76	0.76	0.76
No. in Project	41	38	10

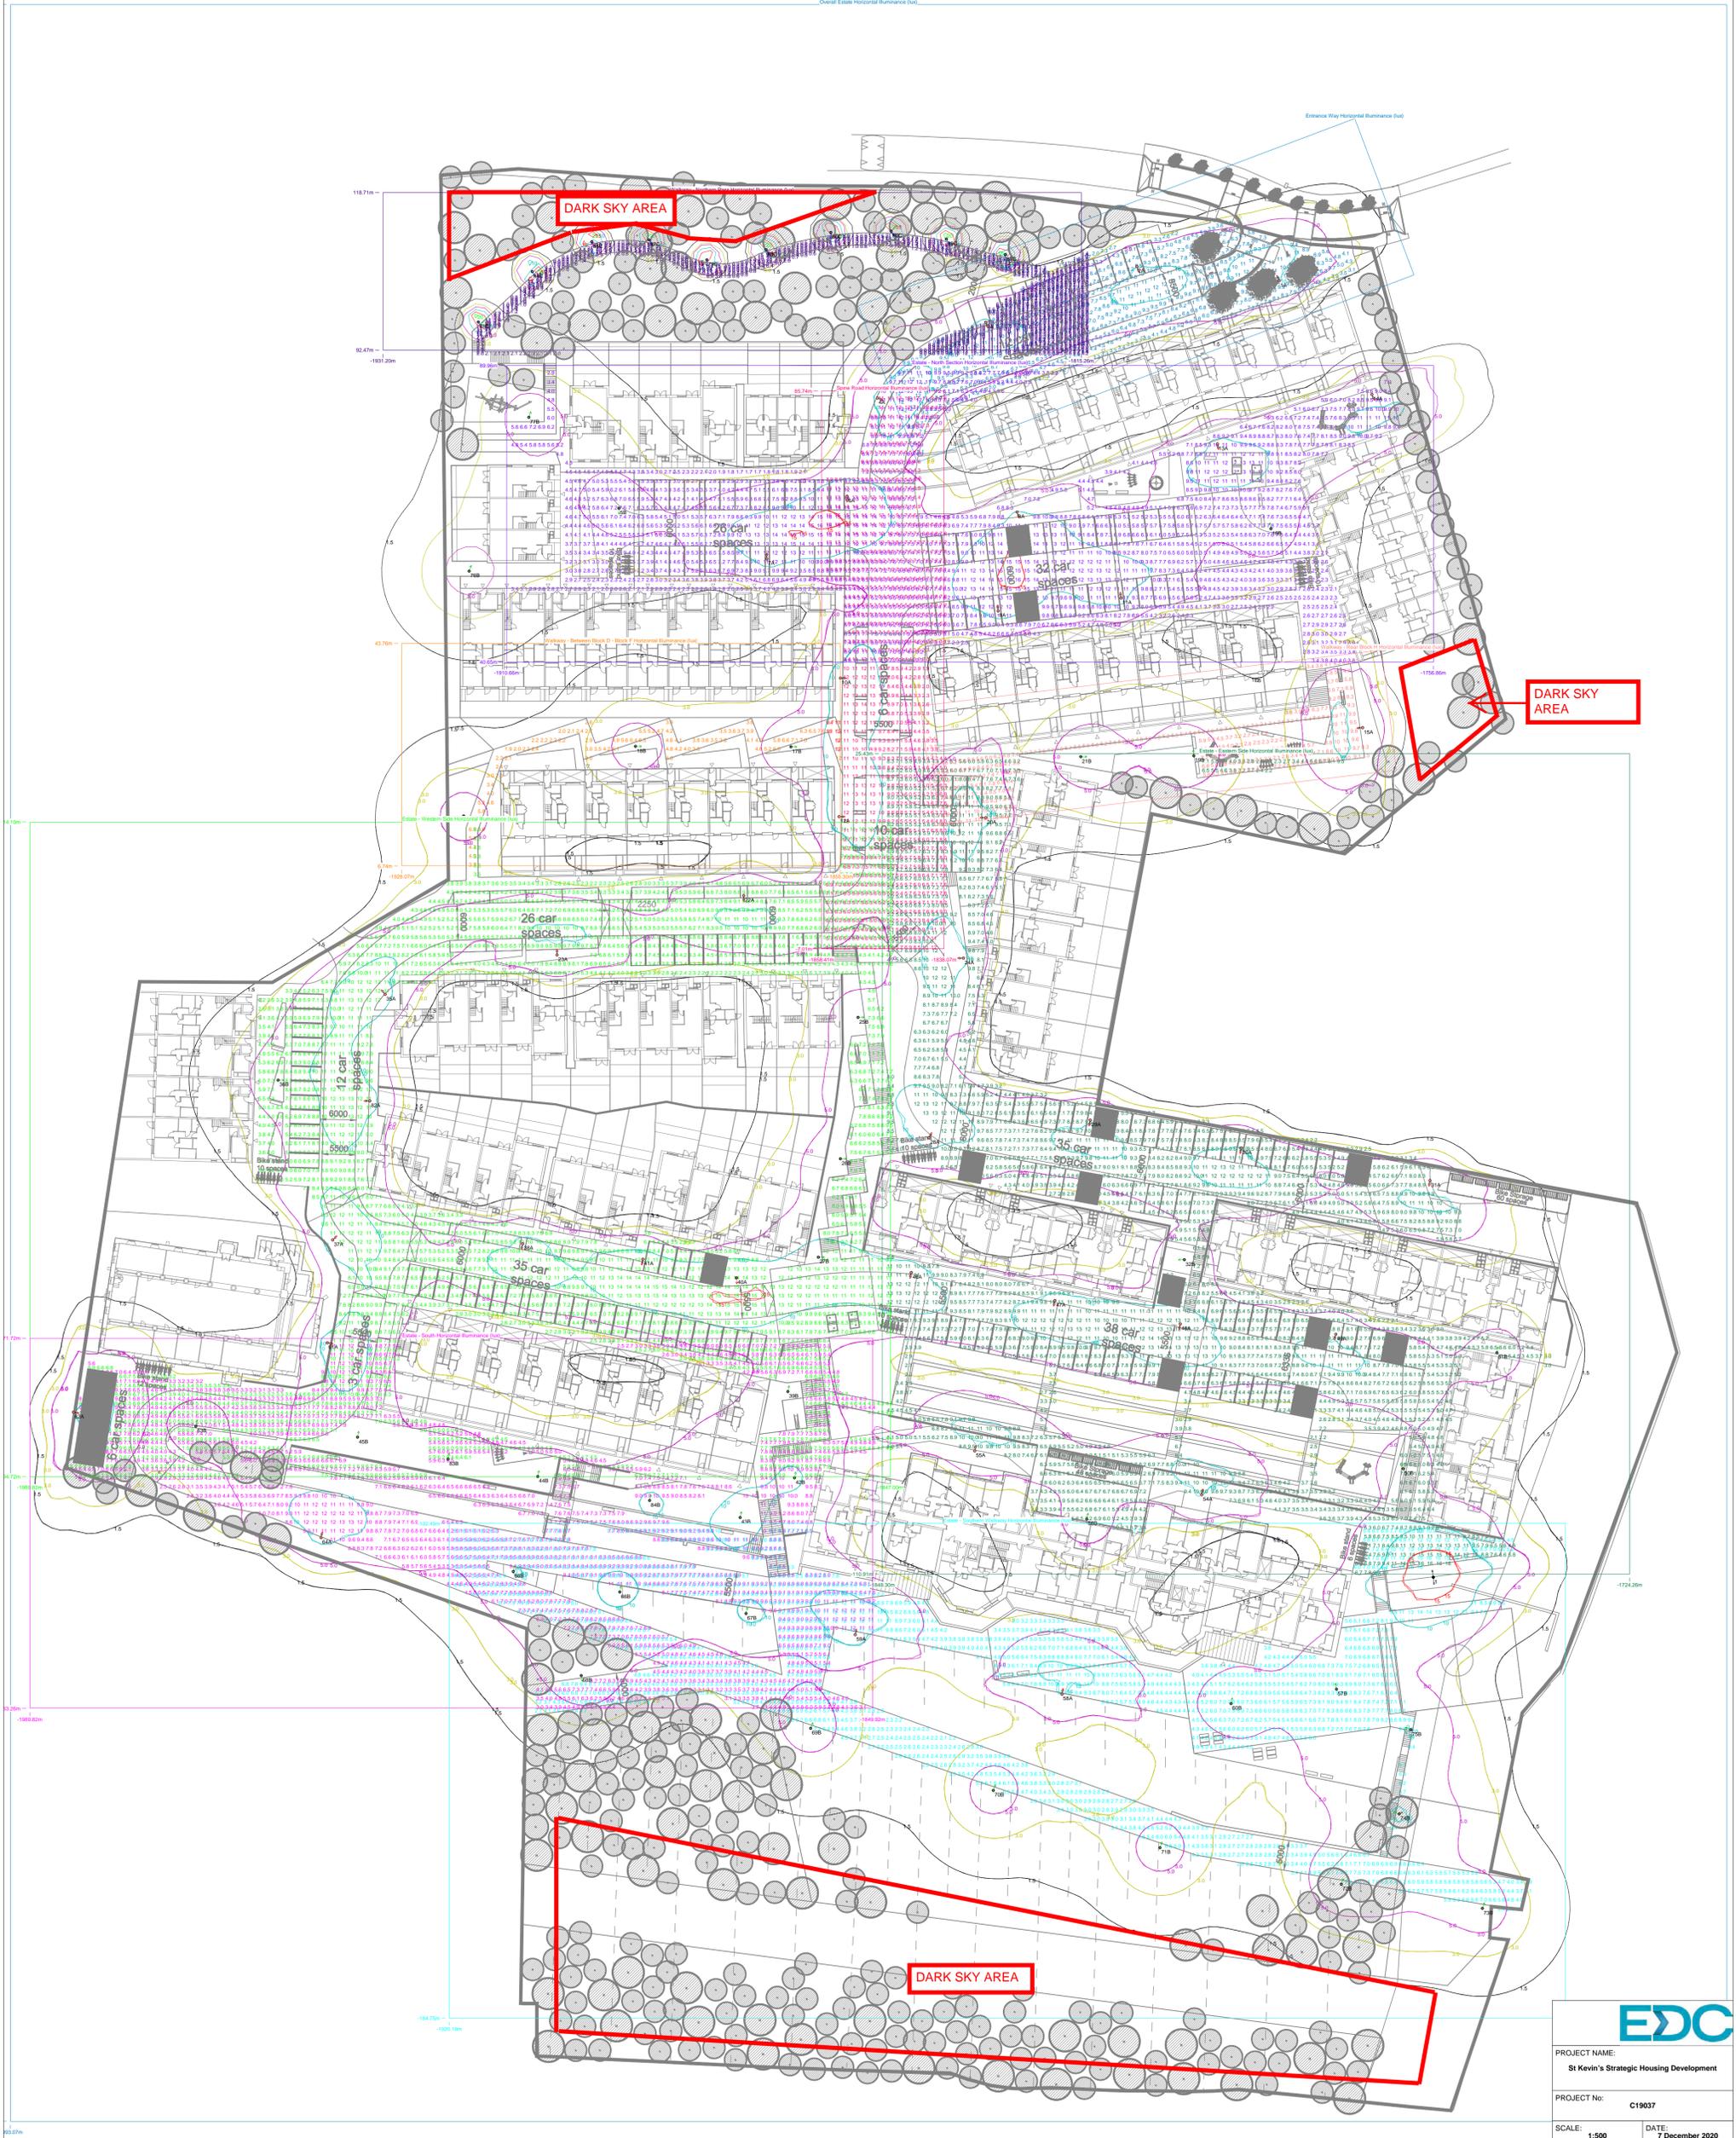

EDC

PROJECT NAME:
St Kevin's Strategic Housing Development

PROJECT NO:
C19037

SCALE: 1:500 DATE: 7 December 2020

CALCULATION:
Horizontal Illuminance (lux)

DESIGNER:
EDC

PREPARED BY:
EDC - Mechanical & Electrical Consulting Engineers
Engineer: Thomas Taylor
Email: taylor@edcengineers.com
Cork Office Tel: +353 (0)21 4280476
Dublin Office Tel: +353 (0)1 5313683
London Office Tel: +44 (0)203 0040062
www.edcengineers.com